


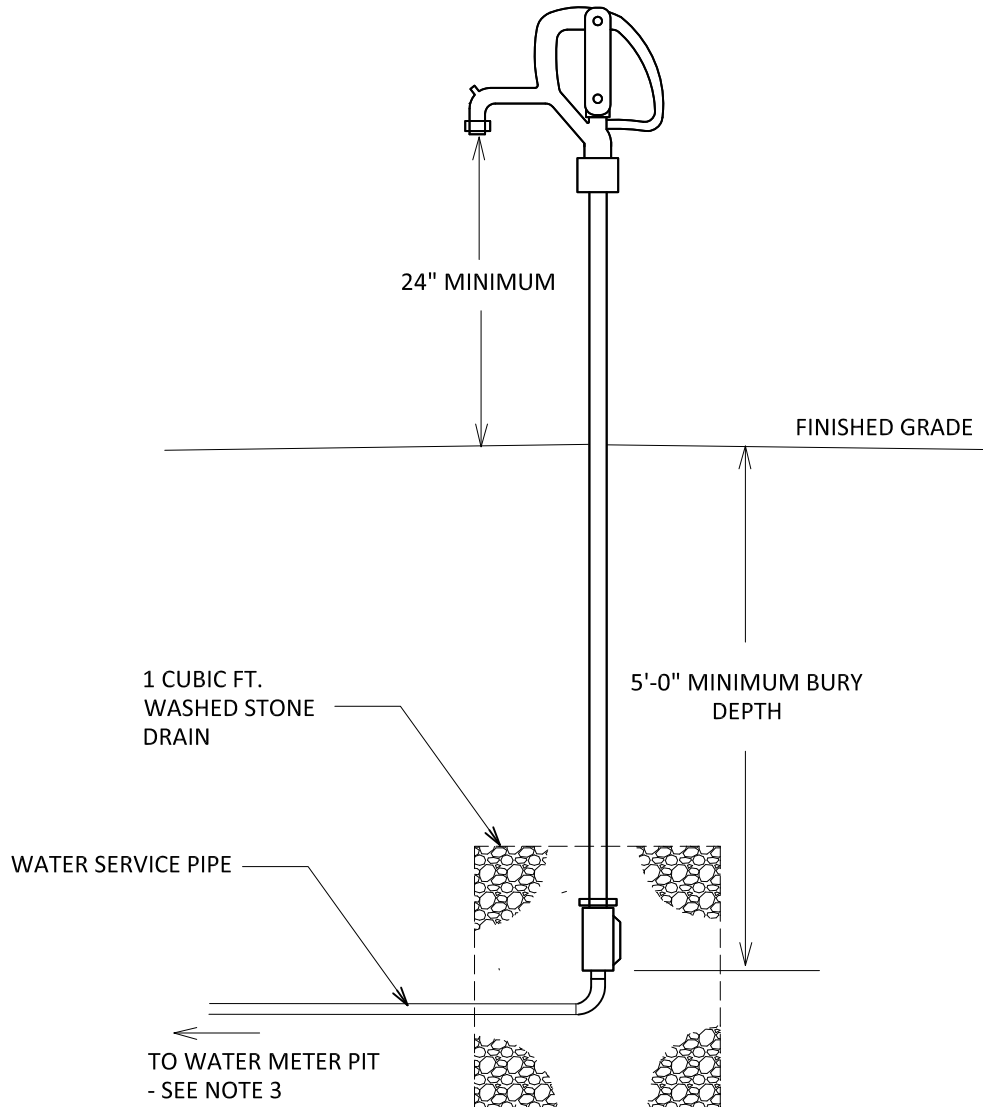

NOTES:

1. YARD HYDRANT TO BE NON-FREEZE TYPE CAPABLE OF BEING LOCKED CLOSED.
2. ALL WATER SERVICES WHERE YARD HYDRANTS ARE INSTALLED MUST BE FURNISHED WITH A BACKFLOW PREVENTION DEVICE, AS APPROVED BY THE WATER BUREAU.
3. FOR WATER SERVICES USED EXCLUSIVELY TO SUPPLY YARD HYDRANTS, A WATER METER PIT (SIZE 1-INCH OR SMALLER) IS TO BE INSTALLED ON THE SERVICE AND THE METER PIT SETTER IS TO BE FURNISHED WITH AN ANGLE BALL VALVE ON INLET SIDE OF METER AND AN ANGLE CARTRIDGE DUAL CHECK VALVE (FOR BACKFLOW PREVENTION) ON OUTLET SIDE OF METER. ONE CONTINUOUS PIECE OF WATER SERVICE PIPE IS TO BE INSTALLED BETWEEN THE OUTLET OF THE METER PIT AND THE YARD HYDRANT.

CITY OF ROCHESTER		
YARD HYDRANT		
ISSUED	5-11-11	NON-STANDARD DWG.NO.S925-1
REVISED		