


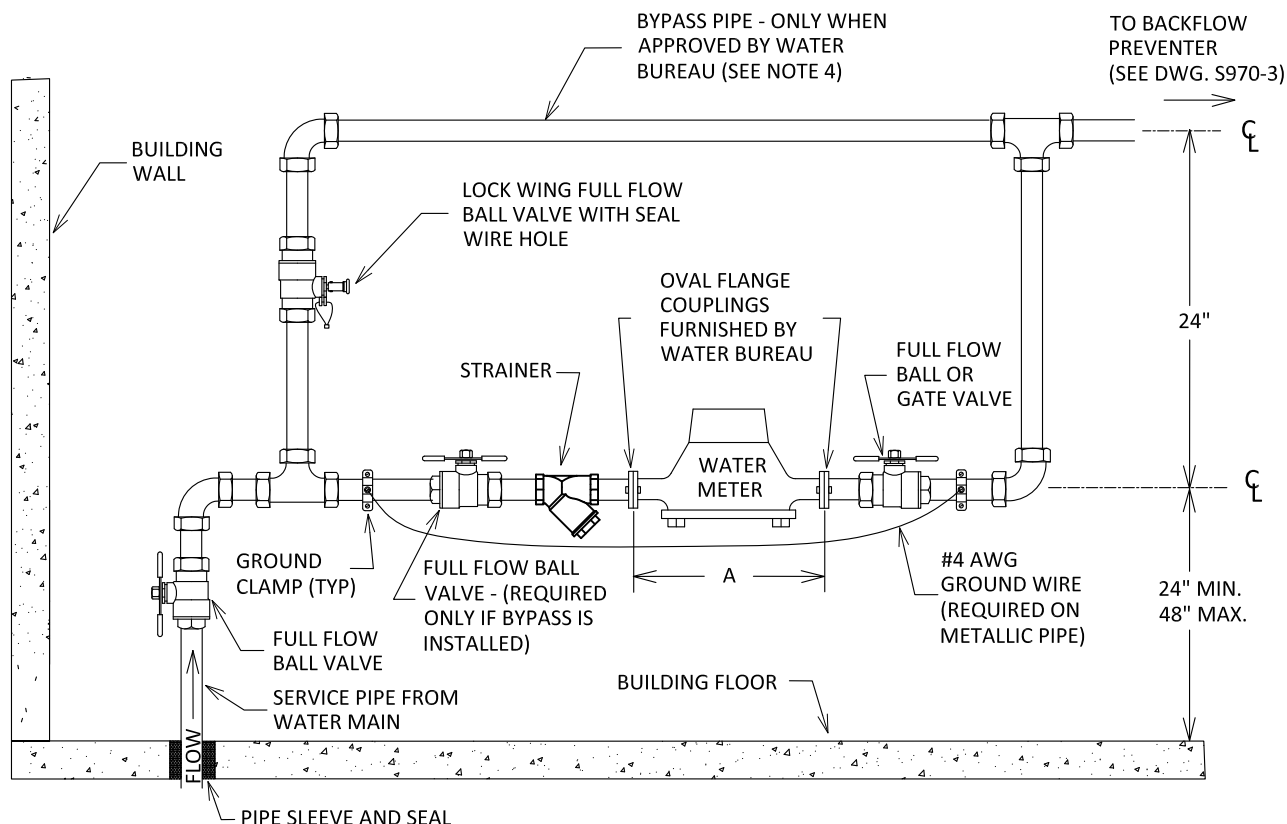

ELEVATION

NOTES:

- METER AND METER COUPLINGS ARE TO BE FURNISHED BY THE WATER BUREAU AND INSTALLED BY THE PLUMBER. METER AND COUPLINGS ARE AVAILABLE FOR PICK-UP AT THE WATER BUREAU OPERATIONS CENTER, 10 FELIX STREET, TELEPHONE 428-7618.
- METERS MUST BE MOUNTED HORIZONTALLY AND SET IN A HEATED LOCATION THAT IS READILY ACCESSIBLE FOR REPAIR, READING AND REPLACEMENT. METERS CAN NOT BE LOCATED IN CRAWL SPACES, CEILINGS OR IN CONFINED SPACES.
- THE WATER BUREAU WILL INSPECT AND SEAL THE METER AND WILL ALSO INSTALL REMOTE TOUCH PAD OR RADIO READING DEVICE.
- BYPASS IS NOT PERMITTED AND WILL NOT BE APPROVED BY THE WATER BUREAU UNLESS A CONTINUOUS SUPPLY OF WATER IS REQUIRED. BYPASS PIPE TO BE SAME SIZE AS MAIN LINE.
- A BACKFLOW PREVENTION DEVICE IS REQUIRED ON ALL DOMESTIC WATER SERVICES 1½" AND LARGER. SEE DWG. S971-1.
- IF THE METER SIZE IS SMALLER THAN THE SERVICE SIZE, ADEQUATE CLEARANCE MUST BE PROVIDED FOR A FULL-SIZED METER.
- PIPE AND APPURTENANCES ARE TO BE ADEQUATELY RESTRAINED, BRACED AND SUPPORTED. ALL WORK AND MATERIALS SHALL BE IN CONFORMANCE WITH APPLICABLE FEDERAL, STATE AND LOCAL PLUMBING CODES.

DIMENSIONS

METER SIZE	METER LENGTH "A"
1½"	13"
2"	17"

CITY OF ROCHESTER

INDOOR INSTALLATION OF WATER METER 1½ INCH AND 2 INCH

ISSUED	7-13-11	NON-STANDARD DWG.NO.S970-3
REVISED	9-16-13	