

**LEGEND**

**852 TOTAL LEAD SERVICES  
TO BE REPLACED**



**PROPOSED 2023 LEAD SERVICE  
LINE REPLACEMENT PROJECT - 3A  
851 TOTALS LEAD SERVICES**

11/17/2022

0 0.075 0.15  
Miles

1" = 0.15 miles


**Water Bureau Contact Information**

Customer Service - (585)428-5990  
Water Bureau Dispatch Office - (585)428-7500  
Water Bureau Maps & Records - (585)428-7562




### LEGEND

230 TOTAL LEAD SERVICES  
TO BE REPLACED

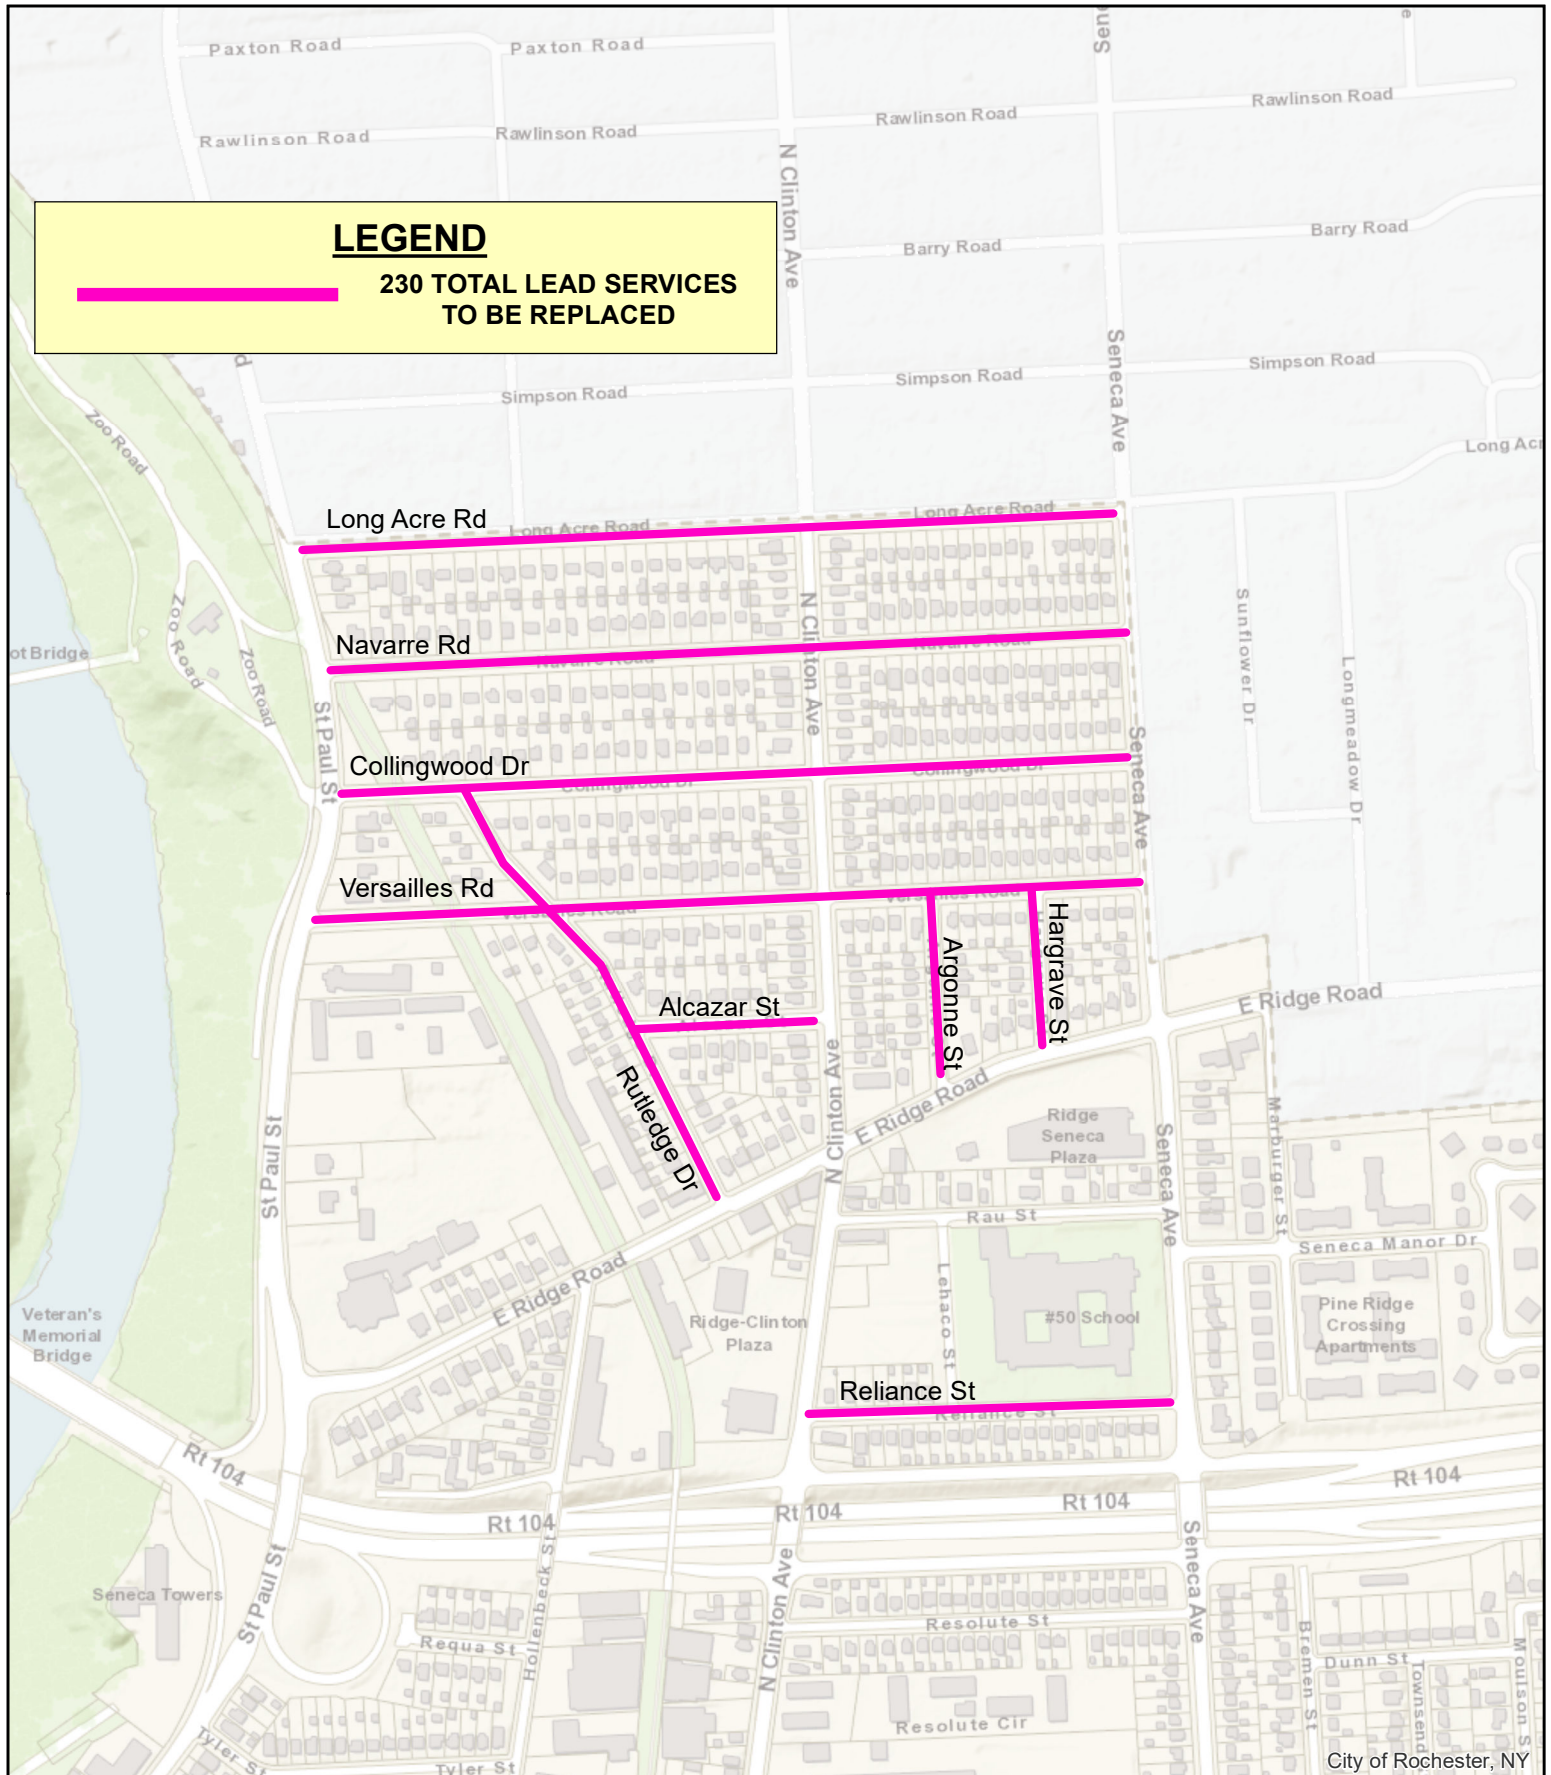

## PROPOSED LSLR CHANGE ORDER #1

11/2/2023



1" = 0.1 miles

### Water Bureau Contact Information

Customer Service - (585)428-5990  
Water Bureau Dispatch Office - (585)428-7500  
Water Bureau Maps & Records - (585)428-7562

City of Rochester, NY

**ALCAZAR ST. (RUTLEDGE DR. TO N CLINTON AV) WATER SERVICE TABLE**

Street Address #	Exist. Corp. Size	Exist. Serv. Size	Exist. Serv. LF	Exist. Serv. Mat.	Exist. Inside Serv. Mat.	Corp. 1" S912.090100	PE Serv. LF 1" S913.130100	CS&B 3/4" S914.060075	CS&B 1" S914.030100	Water Main Diameter	Disposition
8	5/8	5/8	8	Lead	Unknown	1	8		1	6"	Replace Tap, Ser,CS&B
14	5/8	5/8	8	Lead Lined	Copper	1	8		1	6"	Replace Tap, Ser,CS&B
21	5/8	5/8	33	Lead Lined	Unknown	1	33		1	6"	Replace Tap, Ser,CS&B
24	5/8	5/8	8	Lead Lined	Unknown	1	8		1	6"	Replace Tap, Ser,CS&B
27	5/8	5/8	23	Lead Lined	Copper	1	23		1	6"	Replace Tap, Ser,CS&B
30	5/8	5/8	8	Lead Lined	Galvanized	1	8		1	6"	Replace Tap, Ser,CS&B
33	5/8	5/8	23	Lead Lined	Unknown	1	23		1	6"	Replace Tap, Ser,CS&B
38	5/8	5/8	8	Lead Lined	Copper	1	8		1	6"	Replace Tap, Ser,CS&B
39	5/8	5/8	23	Lead Lined	Unknown	1	23		1	6"	Replace Tap, Ser,CS&B
44	5/8	5/8	8	Lead Lined	Unknown	1	8		1	6"	Replace Tap, Ser,CS&B
45	5/8	5/8	23	Lead Lined	Unknown	1	23		1	6"	Replace Tap, Ser,CS&B
<b>TOTALS</b>			173			11	173		11		

**ARGONNE ST. (E RIDGE RD. TO VERSAILLES ST.) WATER SERVICE TABLE**

Street Address #	Exist. Corp. Size	Exist. Serv. Size	Exist. Serv. LF	Exist. Serv. Mat.	Exist. Inside Serv. Mat.	Corp. 1" S912.090100	PE Serv. LF 1" S913.130100	CS&B 3/4" S914.060075	CS&B 1" S914.030100	Water Main Diameter	Disposition
15	5/8	5/8	8	Galvanized	Unknown	1	8		1	6"	Replace Tap, Ser,CS&B
23	5/8	5/8	8	Galvanized	Unknown	1	8		1	6"	Replace Tap, Ser,CS&B
31	5/8	5/8	11	Galvanized	Galvanized	1	11		1	6"	Replace Tap, Ser,CS&B
35	5/8	5/8	11	Galvanized	Unknown	1	11		1	6"	Replace Tap, Ser,CS&B
38	5/8	5/8	25	Galvanized	Unknown	1	25		1	6"	Replace Tap, Ser,CS&B
44	5/8	5/8	25	Galvanized	Copper	1	25		1	6"	Replace Tap, Ser,CS&B
47	5/8	5/8	9	Galvanized	Unknown	1	9		1	6"	Replace Tap, Ser,CS&B
50	5/8	5/8	25	Galvanized	Unknown	1	25		1	6"	Replace Tap, Ser,CS&B
<b>TOTALS</b>			122			8	122		8		

**HARGRAVE ST. (E RIDGE RD. TO VERSAILLES ST.) WATER SERVICE TABLE**

Street Address #	Exist. Corp. Size	Exist. Serv. Size	Exist. Serv. LF	Exist. Serv. Mat.	Exist. Inside Serv. Mat.	Corp. 1" S912.090100	PE Serv. LF 1" S913.130100	CS&B 3/4" S914.060075	CS&B 1" S914.030100	Water Main Diameter	Disposition
23	5/8	5/8	9	Galvanized	Unknown	1	9		1	6"	Replace Tap, Ser,CS&B
25	5/8	5/8	9	Galvanized	Unknown	1	9		1	6"	Replace Tap, Ser,CS&B
35	5/8	5/8	9	Galvanized	Plastic	1	9		1	6"	Replace Tap, Ser,CS&B
36	5/8	5/8	20	Galvanized	Unknown	1	20		1	6"	Replace Tap, Ser,CS&B
<b>TOTALS</b>			47			4	47		4		

**COLLINGWOOD DR. (ST PAUL ST. TO SENECA AV) WATER SERVICE TABLE**

Street Address #	Exist. Corp. Size	Exist. Serv. Size	Exist. Serv. LF	Exist. Serv. Mat.	Exist. Inside Serv. Mat.	Corp. 1" S912.090100	PE Serv. LF 1" S913.130100	CS&B 3/4" S914.060075	CS&B 1" S914.030100	Water Main Diameter	Disposition
26	5/8	5/8	8	Lead	Copper	1	8		1	8"	Replace Tap, Ser,CS&B
34	5/8	5/8	6	Lead Lined	Copper	1	6		1	8"	Replace Tap, Ser,CS&B
40	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
56	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
65	5/8	5/8	23	Lead Lined	Copper	1	23		1	8"	Replace Tap, Ser,CS&B
66	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
74	5/8	5/8	7	Lead Lined	Galvanized	1	7		1	8"	Replace Tap, Ser,CS&B
75	5/8	5/8	23	Lead Lined	Copper	1	23		1	8"	Replace Tap, Ser,CS&B
81	5/8	5/8	23	Lead Lined	Copper	1	23		1	8"	Replace Tap, Ser,CS&B
89	5/8	5/8	23	Lead Lined	Unknown	1	23		1	8"	Replace Tap, Ser,CS&B
90	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
97	5/8	5/8	23	Lead Lined	Copper	1	23		1	8"	Replace Tap, Ser,CS&B
98	5/8	5/8	7	Lead Lined	Plastic	1	7		1	8"	Replace Tap, Ser,CS&B
105	5/8	5/8	23	Lead Lined	Unknown	1	23		1	8"	Replace Tap, Ser,CS&B
106	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
111	5/8	5/8	23	Lead Lined	Copper	1	23		1	8"	Replace Tap, Ser,CS&B
114	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
119	5/8	5/8	23	Lead Lined	Copper	1	23		1	8"	Replace Tap, Ser,CS&B
120	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
127	5/8	5/8	23	Lead Lined	Copper	1	23		1	8"	Replace Tap, Ser,CS&B
128	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
134	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
135	5/8	5/8	23	Lead Lined	Copper	1	23		1	8"	Replace Tap, Ser,CS&B
141	5/8	5/8	23	Lead Lined	Unknown	1	23		1	8"	Replace Tap, Ser,CS&B
142	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
149	5/8	5/8	23	Lead Lined	Unknown	1	23		1	8"	Replace Tap, Ser,CS&B
150	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
199	5/8	5/8	24	Lead Lined	Unknown	1	24		1	8"	Replace Tap, Ser,CS&B
200	5/8	5/8	6	Lead Lined	Copper	1	6		1	8"	Replace Tap, Ser,CS&B
205	5/8	5/8	24	Lead Lined	Unknown	1	24		1	8"	Replace Tap, Ser,CS&B
210	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
211	5/8	5/8	0	Copper	Galvanized	0	0		0	8"	Replace Tap, Ser,CS&B
215	5/8	5/8	23	Lead Lined	Unknown	1	23		1	8"	Replace Tap, Ser,CS&B
216	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
221	5/8	5/8	23	Lead Lined	Plastic	1	23		1	8"	Replace Tap, Ser,CS&B
222	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
228	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
234	5/8	5/8	7	Lead Lined	Plastic	1	7		1	8"	Replace Tap, Ser,CS&B
235	5/8	5/8	23	Lead Lined	Copper	1	23		1	8"	Replace Tap, Ser,CS&B
239	5/8	5/8	23	Lead Lined	Unknown	1	23		1	8"	Replace Tap, Ser,CS&B
240	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
246	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
251	5/8	5/8	24	Lead Lined	Unknown	1	24		1	8"	Replace Tap, Ser,CS&B
252	5/8	5/8	6	Lead Lined	Copper	1	6		1	8"	Replace Tap, Ser,CS&B
256	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
261	5/8	5/8	23	Lead Lined	Copper	1	23		1	8"	Replace Tap, Ser,CS&B
262	5/8	5/8	6	Lead Lined	Unknown	1	6		1	8"	Replace Tap, Ser,CS&B
267	5/8	5/8	24	Lead Lined	Copper	1	24		1	8"	Replace Tap, Ser,CS&B
268	5/8	5/8	6	Lead Lined	Unknown	1	6		1	8"	Replace Tap, Ser,CS&B
273	5/8	5/8	24	Lead Lined	Unknown	1	24		1	8"	Replace Tap, Ser,CS&B
274	5/8	5/8	6	Lead Lined	Unknown	1	6		1	8"	Replace Tap, Ser,CS&B
285	5/8	5/8	24	Galvanized	Galvanized	1	24		1	8"	Replace Tap, Ser,CS&B
TOTALS			726			51	726		51		

**LONG ACRE RD. (ST PAUL ST. TO SENECA AV) WATER SERVICE TABLE**

Street Address #	Exist. Corp. Size	Exist. Serv. Size	Exist. Serv. LF	Exist. Serv. Mat.	Exist. Inside Serv. Mat.	Corp. 1" S912.090100	PE Serv. LF 1" S913.130100	CS&B 3/4" S914.060075	CS&B 1" S914.030100	Water Main Diameter	Disposition
19 (2304 St Paul)	5/8	5/8	8	Lead Lined	Copper	1	8		1	10"	Replace Tap, Ser,CS&B
29	5/8	5/8	8	Lead Lined	Copper	1	8		1	10"	Replace Tap, Ser,CS&B
35	5/8	5/8	17	Lead Lined	Unknown	1	17		1	10"	Replace Tap, Ser,CS&B
43	5/8	5/8	12	Lead Lined	Copper	1	12		1	10"	Replace Tap, Ser,CS&B
51	5/8	5/8	12	Lead Lined	Copper	1	12		1	10"	Replace Tap, Ser,CS&B
57	5/8	5/8	11	Lead Lined	Copper	1	11		1	10"	Replace Tap, Ser,CS&B
75	5/8	5/8	11	Lead Lined	Unknown	1	11		1	10"	Replace Tap, Ser,CS&B
85	5/8	5/8	8	Lead Lined	Unknown	1	8		1	10"	Replace Tap, Ser,CS&B
99	5/8	5/8	8	Lead Lined	Galvanized	1	8		1	10"	Replace Tap, Ser,CS&B
105	5/8	5/8	8	Galvanized	Unknown	1	8		1	10"	Replace Tap, Ser,CS&B
115	5/8	5/8	12	Galvanized	Copper	1	12		1	10"	Replace Tap, Ser,CS&B
121	5/8	5/8	11	Lead Lined	Copper	1	11		1	10"	Replace Tap, Ser,CS&B
145	5/8	5/8	8	Lead Lined	Copper	1	8		1	10"	Replace Tap, Ser,CS&B
151	5/8	5/8	8	Lead Lined	Copper	1	8		1	10"	Replace Tap, Ser,CS&B
159	5/8	5/8	8	Lead Lined	Unknown	1	8		1	10"	Replace Tap, Ser,CS&B
209	5/8	5/8	11	Galvanized	Copper	1	11		1	12"	Replace Tap, Ser,CS&B
215	5/8	5/8	11	Galvanized	Unknown	1	11		1	12"	Replace Tap, Ser,CS&B
225	5/8	5/8	11	Galvanized	Copper	1	11		1	12"	Replace Tap, Ser,CS&B
231	5/8	5/8	11	Galvanized	Galvanized	1	11		1	12"	Replace Tap, Ser,CS&B
243	5/8	5/8	11	Galvanized	Copper	1	11		1	12"	Replace Tap, Ser,CS&B
265	5/8	5/8	8	Lead Lined	Unknown	1	8		1	12"	Replace Tap, Ser,CS&B
277	5/8	5/8	11	Galvanized	Copper	1	11		1	12"	Replace Tap, Ser,CS&B
283	5/8	5/8	8	Lead Lined	Unknown	1	8		1	12"	Replace Tap, Ser,CS&B
289	5/8	5/8	8	Lead Lined	Copper	1	8		1	12"	Replace Tap, Ser,CS&B
291 (567 Seneca Av)	5/8	5/8	8	Galvanized	Unknown	1	8		1	12"	Replace Tap, Ser,CS&B
TOTALS			248			25	248		25		

**RELIANCE ST. (N CLINTON AV. TO SENECA AV) WATER SERVICE TABLE**

Street Address #	Exist. Corp. Size	Exist. Serv. Size	Exist. Serv. LF	Exist. Serv. Mat.	Exist. Inside Serv. Mat.	Corp. 1" S912.090100	PE Serv. LF 1" S913.130100	CS&B 3/4" S914.060075	CS&B 1" S914.030100	Water Main Diameter	Disposition
15-17	5/8	5/8	21	Galvanized	Galvanized	1	21		1	8"	Replace Tap, Ser,CS&B
26	5/8	5/8	9	Galvanized	Unknown	1	9		1	8"	Replace Tap, Ser,CS&B
32	5/8	5/8	10	Galvanized	Unknown	1	10		1	8"	Replace Tap, Ser,CS&B
33	5/8	5/8	22	Galvanized	Copper	1	22		1	8"	Replace Tap, Ser,CS&B
38	5/8	5/8	8	Galvanized	Unknown	1	8		1	8"	Replace Tap, Ser,CS&B
39	5/8	5/8	21	Galvanized	Unknown	1	21		1	8"	Replace Tap, Ser,CS&B
44	5/8	5/8	8	Galvanized	Copper	1	8		1	8"	Replace Tap, Ser,CS&B
51	5/8	5/8	23	Galvanized	Unknown	1	23		1	8"	Replace Tap, Ser,CS&B
59	5/8	5/8	22	Galvanized	Copper	1	22		1	8"	Replace Tap, Ser,CS&B
65	5/8	5/8	21	Lead Lined	Galvanized	1	21		1	8"	Replace Tap, Ser,CS&B
69	5/8	5/8	22	Galvanized	Unknown	1	22		1	8"	Replace Tap, Ser,CS&B
75	5/8	5/8	23	Galvanized	Copper	1	23		1	8"	Replace Tap, Ser,CS&B
79	5/8	5/8	22	Galvanized	Copper	1	22		1	8"	Replace Tap, Ser,CS&B
85	5/8	5/8	23	Galvanized	Unknown	1	23		1	8"	Replace Tap, Ser,CS&B
91	5/8	5/8	22	Galvanized	Unknown	1	22		1	8"	Replace Tap, Ser,CS&B
113	5/8	5/8	21	Galvanized	Copper	1	21		1	8"	Replace Tap, Ser,CS&B
TOTALS			298			16	298		16		

**NAVARRE RD. (ST PAUL ST. TO SENECA AV) WATER SERVICE TABLE**

Street Address #	Exist. Corp. Size	Exist. Serv. Size	Exist. Serv. LF	Exist. Serv. Mat.	Exist. Inside Serv. Mat.	Corp. 1" S912.090100	PE Serv. LF 1" S913.130100	CS&B 3/4" S914.060075	CS&B 1" S914.030100	Water Main Diameter	Disposition
10	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
15	5/8	5/8	23	Lead Lined	Unknown	1	23		1	8"	Replace Tap, Ser,CS&B
18	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
26	5/8	5/8	12	Lead	Copper	1	12		1	8"	Replace Tap, Ser,CS&B
33	5/8	5/8	29	Lead	Copper	1	29		1	8"	Replace Tap, Ser,CS&B
43	5/8	5/8	23	Lead Lined	Galvanized	1	23		1	8"	Replace Tap, Ser,CS&B
49	5/8	5/8	23	Lead Lined	Unknown	1	23		1	8"	Replace Tap, Ser,CS&B
50	5/8	5/8	13	Lead	Unknown	1	13		1	8"	Replace Tap, Ser,CS&B
60	5/8	5/8	12	Lead	Galvanized	1	12		1	8"	Replace Tap, Ser,CS&B
66	5/8	5/8	6	Lead Lined	Galvanized	1	6		1	8"	Replace Tap, Ser,CS&B
70	5/8	5/8	6	Lead Lined	Copper	1	6		1	8"	Replace Tap, Ser,CS&B
80	5/8	5/8	6	Lead Lined	Unknown	1	6		1	8"	Replace Tap, Ser,CS&B
90	5/8	5/8	6	Lead Lined	Copper	1	6		1	8"	Replace Tap, Ser,CS&B
99	5/8	5/8	22	Lead Lined	Unknown	1	22		1	8"	Replace Tap, Ser,CS&B
100	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
105	5/8	5/8	22	Lead Lined	Galvanized	1	22		1	8"	Replace Tap, Ser,CS&B
106	5/8	5/8	12	Lead	Galvanized	1	12		1	8"	Replace Tap, Ser,CS&B
111	5/8	5/8	22	Lead Lined	Unknown	1	22		1	8"	Replace Tap, Ser,CS&B
120	5/8	5/8	8	Lead Lined	Copper	1	8		1	8"	Replace Tap, Ser,CS&B
121	5/8	5/8	22	Lead Lined	Unknown	1	22		1	8"	Replace Tap, Ser,CS&B
127	5/8	5/8	22	Lead Lined	Unknown	1	22		1	8"	Replace Tap, Ser,CS&B
128	5/8	5/8	7	Lead Lined	Galvanized	1	7		1	8"	Replace Tap, Ser,CS&B
135	5/8	5/8	23	Lead Lined	Unknown	1	23		1	8"	Replace Tap, Ser,CS&B
136	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
143	5/8	5/8	23	Lead Lined	Copper	1	23		1	8"	Replace Tap, Ser,CS&B
144	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
150	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
151	5/8	5/8	23	Lead Lined	Unknown	1	23		1	8"	Replace Tap, Ser,CS&B
199	5/8	5/8	22	Lead Lined	Unknown	1	22		1	8"	Replace Tap, Ser,CS&B
200	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
205	5/8	5/8	22	Lead Lined	Unknown	1	22		1	8"	Replace Tap, Ser,CS&B
206	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
212	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
215	5/8	5/8	22	Lead Lined	Copper	1	22		1	8"	Replace Tap, Ser,CS&B
218	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
223	5/8	5/8	22	Lead Lined	Copper	1	22		1	8"	Replace Tap, Ser,CS&B
224	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
229	5/8	5/8	22	Lead Lined	Unknown	1	22		1	8"	Replace Tap, Ser,CS&B
232	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
236	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
239	5/8	5/8	22	Lead Lined	Unknown	1	22		1	8"	Replace Tap, Ser,CS&B
240	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
245	5/8	5/8	22	Lead Lined	Unknown	1	22		1	8"	Replace Tap, Ser,CS&B
246	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
251	5/8	5/8	22	Lead Lined	Copper	1	22		1	8"	Replace Tap, Ser,CS&B
252	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
263	5/8	5/8	22	Lead Lined	Copper	1	22		1	8"	Replace Tap, Ser,CS&B
264	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
268	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
269	5/8	5/8	22	Lead Lined	Plastic	1	22		1	8"	Replace Tap, Ser,CS&B
272	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
274	5/8	5/8	7	Lead Lined	Galvanized	1	7		1	8"	Replace Tap, Ser,CS&B
279	5/8	5/8	23	Lead Lined	Copper	1	23		1	8"	Replace Tap, Ser,CS&B
286	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
TOTALS			755			54	755		54		

**RUTLEDGE DR. (COLLINGWOOD DR. TO E RIDGE RD.) WATER SERVICE TABLE**

Street Address #	Exist. Corp. Size	Exist. Serv. Size	Exist. Serv. LF	Exist. Serv. Mat.	Exist. Inside Serv. Mat.	Corp. 1" S912.09010 0	PE Serv. LF 1" S913.13010 0	CS&B 3/4" S914.06007 5	CS&B 1" S914.03010 0	Water Main Diameter	Disposition
173 (35 Collingwood Dr)	5/8	5/8	7	Lead	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
161	5/8	5/8	7	Lead	Galvanized	1	7		1	8"	Replace Tap, Ser,CS&B
160 (55 Collingwood Dr)	5/8	5/8	22	Lead Lined	Copper	1	22		1	8"	Replace Tap, Ser,CS&B
151	5/8	5/8	7	Lead	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
140	5/8	5/8	22	Lead Lined	Plastic	1	22		1	8"	Replace Tap, Ser,CS&B
111 (81 Versailles Rd)	5/8	5/8	7	Lead	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
95	5/8	5/8	7	Lead	Galvanized	1	7		1	8"	Replace Tap, Ser,CS&B
89	5/8	5/8	10	Lead	Galvanized	1	10		1	8"	Replace Tap, Ser,CS&B
80	5/8	5/8	21	Lead Lined	Unknown	1	21		1	8"	Replace Tap, Ser,CS&B
77	5/8	5/8	10	Lead	Copper	1	10		1	8"	Replace Tap, Ser,CS&B
71	5/8	5/8	10	Lead	Unknown	1	10		1	8"	Replace Tap, Ser,CS&B
65	5/8	5/8	10	Lead	Unknown	1	10		1	8"	Replace Tap, Ser,CS&B
59	5/8	5/8	10	Lead	Galvanized	1	10		1	8"	Replace Tap, Ser,CS&B
47	5/8	5/8	9	Lead	Copper	1	9		1	8"	Replace Tap, Ser,CS&B
41	5/8	5/8	9	Lead	Unknown	1	9		1	8"	Replace Tap, Ser,CS&B
40	5/8	5/8	25	Lead	Unknown	1	25		1	8"	Replace Tap, Ser,CS&B
35	5/8	5/8	9	Lead	Copper	1	9		1	8"	Replace Tap, Ser,CS&B
30	5/8	5/8	21	Lead	Unknown	1	21		1	8"	Replace Tap, Ser,CS&B
29	5/8	5/8	9	Lead Lined	Galvanized	1	9		1	8"	Replace Tap, Ser,CS&B
24	5/8	5/8	21	Lead Lined	Unknown	1	21		1	8"	Replace Tap, Ser,CS&B
23	5/8	5/8	9	Lead	Copper	1	9		1	8"	Replace Tap, Ser,CS&B
TOTALS			262			21	262		21		

**VERSAILLES RD. (ST PAUL ST. TO SENECA AV) WATER SERVICE TABLE**

Street Address #	Exist. Corp. Size	Exist. Serv. Size	Exist. Serv. LF	Exist. Serv. Mat.	Exist. Inside Serv. Mat.	Corp. 1" S912.09010 0	PE Serv. LF 1" S913.13010 0	CS&B 3/4" S914.06007 5	CS&B 1" S914.03010 0	Water Main Diameter	Disposition
65	5/8	5/8	7	Lead Lined	Plastic	1	7		1	4"	Replace Tap, Ser,CS&B
69	5/8	5/8	7	Lead Lined	Copper	1	7		1	4"	Replace Tap, Ser,CS&B
77	5/8	5/8	7	Lead Lined	Unknown	1	7		1	4"	Replace Tap, Ser,CS&B
78 (135 Rutledge Dr)	5/8	5/8	22	Lead Lined	Copper	1	22		1	4"	Replace Tap, Ser,CS&B
102	5/8	5/8	16	Lead	Unknown	1	16		1	8"	Replace Tap, Ser,CS&B
110	5/8	5/8	7	Lead Lined	Galvanized	1	7		1	8"	Replace Tap, Ser,CS&B
119	5/8	5/8	22	Lead Lined	Copper	1	22		1	8"	Replace Tap, Ser,CS&B
120	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
127	5/8	5/8	22	Lead Lined	Unknown	1	22		1	8"	Replace Tap, Ser,CS&B
134	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
141	5/8	5/8	22	Lead Lined	Plastic	1	22		1	8"	Replace Tap, Ser,CS&B
146	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
155	5/8	5/8	22	Lead Lined	Galvanized	1	22		1	8"	Replace Tap, Ser,CS&B
158	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
164	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
203	5/8	5/8	22	Lead Lined	Copper	1	22		1	8"	Replace Tap, Ser,CS&B
209	5/8	5/8	22	Lead Lined	Unknown	1	22		1	8"	Replace Tap, Ser,CS&B
214	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
215	5/8	5/8	22	Lead Lined	Plastic	1	22		1	8"	Replace Tap, Ser,CS&B
220	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
223	5/8	5/8	22	Lead Lined	Unknown	1	22		1	8"	Replace Tap, Ser,CS&B
230	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
235	5/8	5/8	22	Lead Lined	Unknown	1	22		1	8"	Replace Tap, Ser,CS&B
236	5/8	5/8	7	Lead Lined	Galvanized	1	7		1	8"	Replace Tap, Ser,CS&B
240	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
244	5/8	5/8	7	Lead Lined	Galvanized	1	7		1	8"	Replace Tap, Ser,CS&B
250	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
254	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
255	5/8	5/8	22	Lead Lined	Galvanized	1	22		1	8"	Replace Tap, Ser,CS&B
260	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
261	5/8	5/8	22	Lead Lined	Unknown	1	22		1	8"	Replace Tap, Ser,CS&B
266	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
272	5/8	5/8	7	Lead Lined	Copper	1	7		1	8"	Replace Tap, Ser,CS&B
275	5/8	5/8	22	Lead Lined	Unknown	1	22		1	8"	Replace Tap, Ser,CS&B
278	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
281	5/8	5/8	22	Lead Lined	Unknown	1	22		1	8"	Replace Tap, Ser,CS&B
284	5/8	5/8	7	Lead Lined	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
287	5/8	5/8	22	Lead Lined	Copper	1	22		1	8"	Replace Tap, Ser,CS&B
296	5/8	5/8	7	Galvanized	Unknown	1	7		1	8"	Replace Tap, Ser,CS&B
301	5/8	5/8	22	Lead Lined	Copper	1	22		1	8"	Replace Tap, Ser,CS&B
TOTALS			529			40	529		40		