UNDERDRAIN DEPTH DIMENSION		
PAVEMENT TYPE	A	B
LIGHT DUTY	2′-2″	2′-10″
MEDIUM DUTY	2′-5″	3′-1″

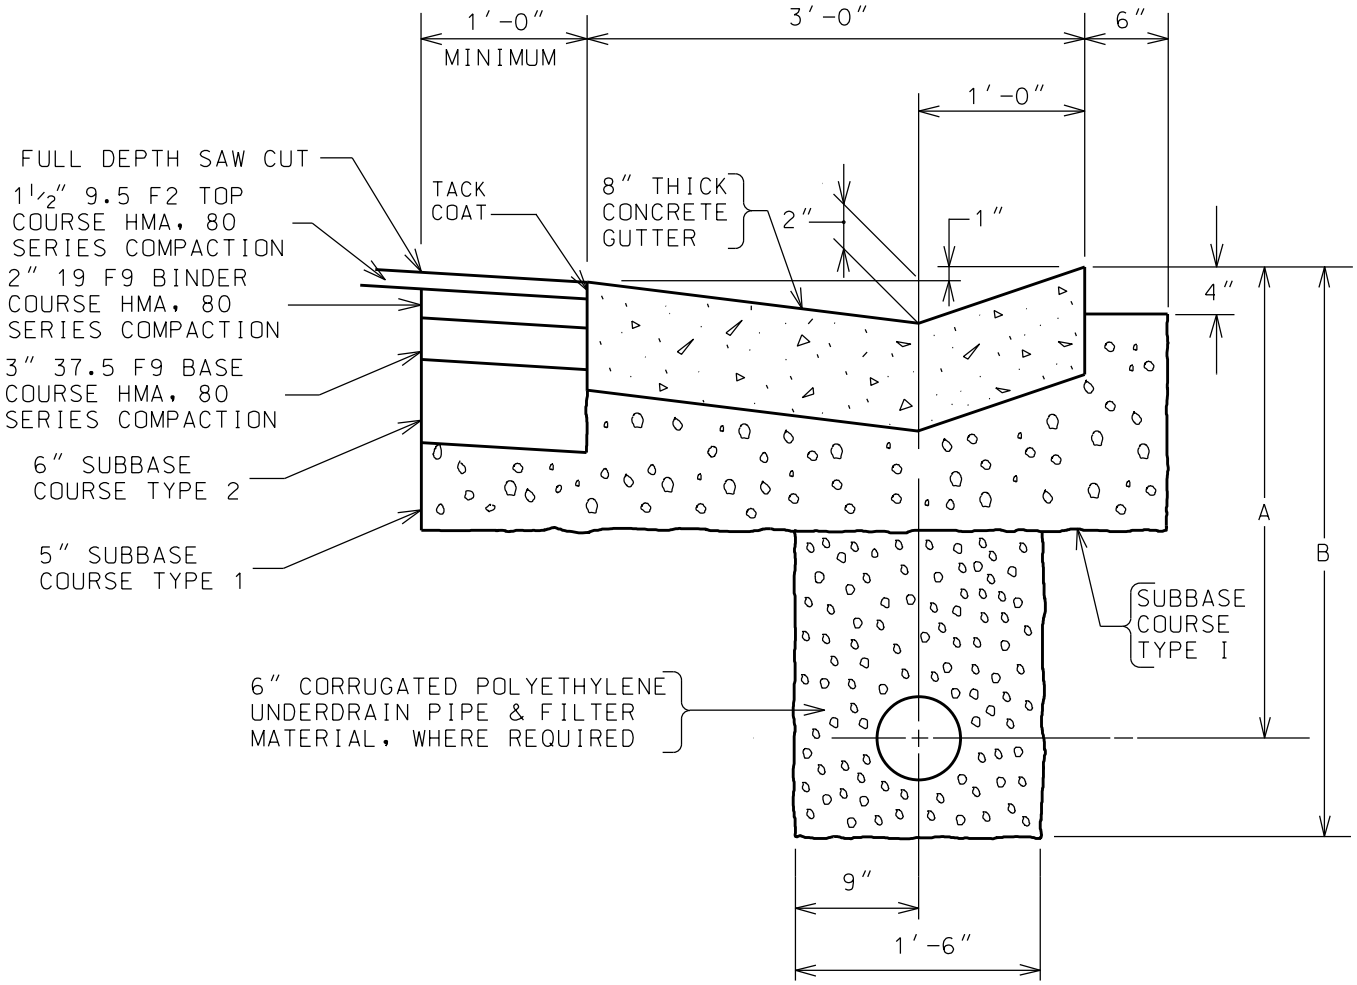

NOTES:

1. REPLACE FULL LENGTH GUTTER SEGMENTS ONLY.
2. USE CLASS K CONCRETE FOR CONVENTIONALLY FORMED GUTTERS, AND CLASS I CONCRETE FOR MACHINE FORMED GUTTERS.
3. EXPANSION JOINTS ARE TO BE PROVIDED AT 20 FOOT INTERVALS AND ARE TO BE ¾INCH IN WIDTH.

CITY OF ROCHESTER

CONCRETE GUTTER REPLACEMENT

ISSUED	9-2-91	STD. DWG.
REVISED	6-16-94	NO. R624-2